ORNL/TM-6830/P2

ornl

OAK
RIDGE
NATIONAL
LABORATORY

UNION
CARBIDE

District Heating/Cogeneration Application Studies for the Minneapolis-St. Paul Area

Executive Summary: Overall Feasibility and Economic Viability for a District Heating/New Cogeneration System in Minneapolis-St. Paul

Peter Margen
Lars-Åke Cronholm
Kjell Larsson
Jan-Erik Marklund
Studsvik Energiteknik AB

OPERATED BY
UNION CARBIDE CORPORATION
FOR THE UNITED STATES
DEPARTMENT OF ENERGY

Printed in the United States of America. Available from
National Technical Information Service
U.S. Department of Commerce
5285 Port Royal Road, Springfield, Virginia 22161
NTIS price codes—Printed Copy: A03; Microfiche A01

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use or the results of such use of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

ORNL/TM-6830/P2
Dist. Category UC-95d

Contract No. W-7405-eng-26

ENGINEERING TECHNOLOGY DIVISION

ENERGY DIVISION

DISTRICT HEATING/COGENERATION APPLICATION STUDIES FOR THE MINNEAPOLIS-ST. PAUL AREA

EXECUTIVE SUMMARY: OVERALL FEASIBILITY AND ECONOMIC VIABILITY FOR A DISTRICT HEATING/NEW COGENERATION SYSTEM IN MINNEAPOLIS-ST. PAUL

Peter Margen Lars-Åke Cronholm
Kjell Larsson Jan-Erik Marklund

Studsvik Energiteknik AB

Date Published — August 1979

Research sponsored by the Division of Buildings and Community Systems and Division of Advanced Nuclear Systems and Projects

Research performed under Subcontract No. 11Y-13502-V with Studsvik Energiteknik AB under Union Carbide Corporation Contract No. W-7405-eng-26 with the U.S. Department of Energy

Prepared by the
OAK RIDGE NATIONAL LABORATORY
Oak Ridge, Tennessee 37830
operated by
UNION CARBIDE CORPORATION
for the
DEPARTMENT OF ENERGY

REPORTS IN THIS SERIES

General Title: DISTRICT HEATING/COGENERATION APPLICATION STUDIES FOR THE MINNEAPOLIS-ST. PAUL AREA

ORNL/TM-6830/P1. *The Feasibility of a District Heating/Cogeneration System for a Northern U.S. City.* To be issued January 1980.

ORNL/TM-6830/P2. *Executive Summary: Overall Feasibility and Economic Viability for a District Heating/New Cogeneration System in Minneapolis-St. Paul.* To be issued August 1979.

ORNL/TM-6830/P3. *Overall Feasibility and Economic Viability for a District Heating/New Cogeneration System in Minneapolis-St. Paul.* To be issued August 1979.

ORNL/TM-6830/P4. *Methods and Cost Estimates for Converting Existing Buildings to Hot Water District Heating.* To be issued September 1979.

ORNL/TM-6830/P5. *Institutional Issues of a New District Heating/Cogeneration System — Ownership Options, Barriers, and Implementation Strategy.* To be issued October 1979.

ORNL/TM-6830/P6. *A Net Energy Analysis of a Cogeneration-District Heating System and Two Conventional Alternatives.* To be issued September 1979.

ORNL/TM-6830/P7. *Application of an Intermediate LWR for Electricity Production and Hot Water District Heating.* To be issued January 1980.

ORNL/TM-6830/P8. *An Assessment of New Coal-Fueled, Cogeneration Power Plants for Electricity Production and Hot Water District Heating.* To be issued April 1980.

ORNL/TM-6830/P9. *Modifications of the Existing Units at the High Bridge Power Plant to Cogeneration for Hot Water District Heating.* To be issued November 1979.

ORNL/TM-6830/P10. *Market Development and Economic Analysis of Expanding the NSP District Heating System in St. Paul.* To be issued December 1979.

ORNL/TM-6830/P11. *Impact of a District Heating/Cogeneration System on Annual Average SO_2 Air Quality in the Twin Cities.* To be issued October 1979.

CONTENTS

		Page
ABSTRACT		v
1.	BACKGROUND	1
2.	THE TWIN CITIES AREA	1
3.	SCOPE OF STUDY	3
	3.1 Principal Features of Proposed Concept	5
	3.2 Methods for Calculations and Cost Estimates	7
4.	FUEL SAVINGS	8
5.	REQUIRED INVESTMENTS	9
6.	ECONOMICS	9
	6.1 Inflation and Fuel Costs	11
	6.2 Capital Charges	13
	6.3 Results	13
	6.4 Sensitivity to Variations in Assumptions	15
7.	ENVIRONMENT	19
8.	INSTITUTIONAL ISSUES	19
9.	CONCLUSIONS	20

ABSTRACT

A study was undertaken to determine the feasibility of introducing a large-scale, hot water, district heating system for the Minneapolis-St. Paul area. The analysis was based on modern European hot water district heating concepts in which cogeneration power plants supply the base-load thermal energy. Heat would be supplied from converted turbines of existing coal-fired power plants in Minneapolis and St. Paul. Toward the end of the 20-year development period, one or two new cogeneration units would be required. Thus, the district heating system could use low-grade heat from either coal-fired or nuclear cogeneration power stations to replace the space heating fuels currently used — natural gas and distillate oil.

The following conclusions can be drawn: the concept is technically feasible, it has great value for fuel conservation, and with appropriate financing the system is economically viable.

1. BACKGROUND

Contacts between Studsvik,* the U.S. Department of Energy (DOE), and Oak Ridge National Laboratory (ORNL) in 1977 resulted in a proposal for studying the technique of introducing district heating on a large regional scale in a suitable metropolitan area in the United States. The district heating system would replace fuels in limited supply — gas and oil — by using thermal energy from coal or nuclear cogeneration power plants. After further contacts with key personnel in several cities and states, the Twin Cities area — Minneapolis and St. Paul, Minnesota — was selected as the location for the study.

The overall study contract was awarded to Studsvik, and ORNL was to serve as coordinator of the various activities. The Minnesota Energy Agency (MEA), local utilities, and local consultants became deeply involved. This report is an executive summary of work completed under the contract. Several phases of the study are being pursued in more detail by the electric utility, Northern States Power Company (NSP); MEA; and local consultants. Although the study is site specific, the general methodology is considered to be applicable for other cities in the northern area of the United States.

2. THE TWIN CITIES AREA

The Twin Cities area encompasses two concentrated municipalities about 7 miles apart — one in Minneapolis and one in St. Paul (Fig. 1). These areas are surrounded by a region of industrial sites and residential housing that links the areas into one continuous metropolitan region. The total metropolitan population of over 1 million includes 0.8 million within the two city boundaries. This dense population, coupled with the cold climate (>8000 Fahrenheit degree-days), creates a large heat demand.

*Studsvik Energiteknik AB, formerly AB Atomenergi.

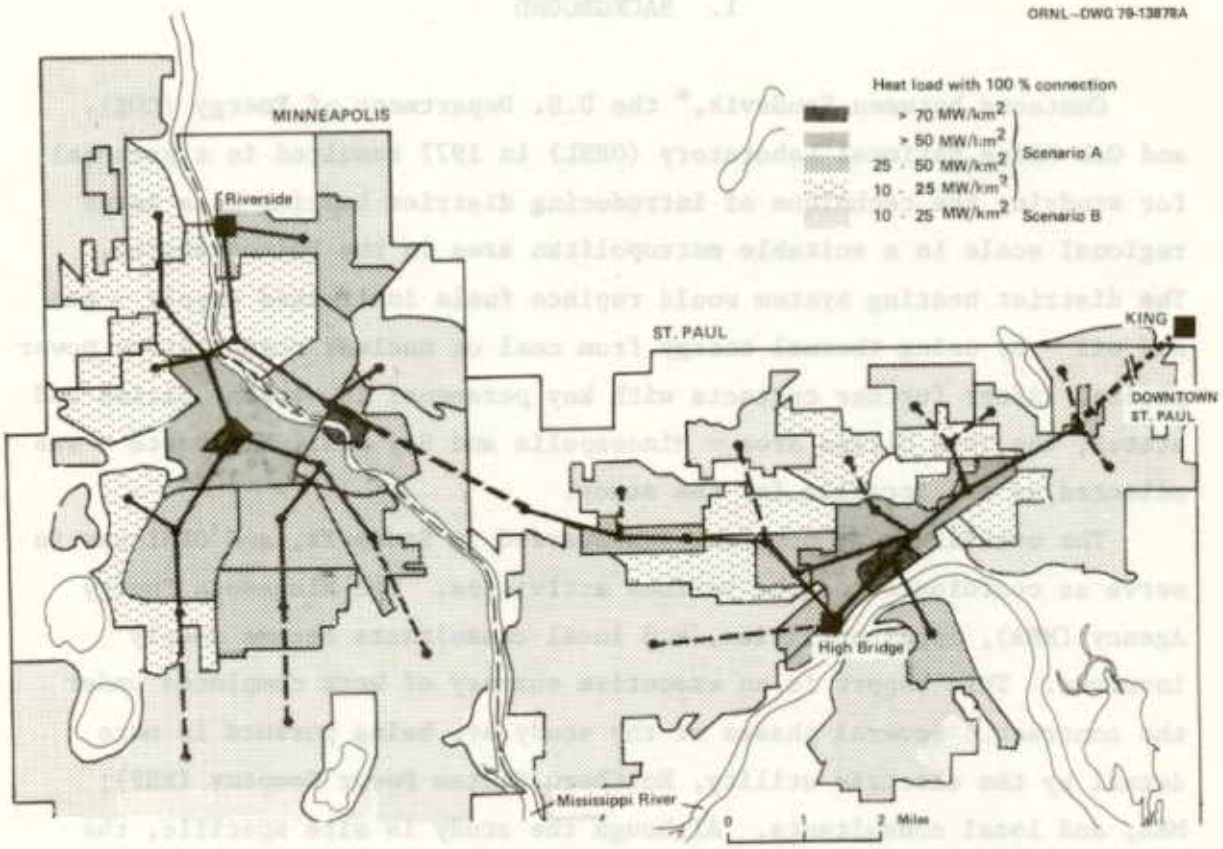

Fig. 1. Heat load densities in the Twin Cities area and possible regional piping systems.

Most of the heat demand is presently supplied by natural gas; however, gas supplies for the larger customers are interrupted during winter and replaced by oil. There are three small steam-based district heating systems in the area — an old one in downtown St. Paul [60 MW(t)], a fairly new one in downtown Minneapolis [about 80 MW(t), including also some district cooling], and one at the University of Minnesota [about 125 MW(t) also including some cooling]. These systems all use steam as the distribution medium and none uses cogeneration; however, a cogeneration plant has been proposed for the University. Thus, gas and oil have been the main fuels for district heating, with some conversion to coal at St. Paul and the University.

There are two fairly large coal-fired electric generating stations within the city boundaries — High Bridge for St. Paul and Riverside for Minneapolis — as shown in Fig. 1. A third station, Black Dog, is located about 10 miles south of Minneapolis, and there are several newer coal-fired and nuclear plants outside the metropolitan area. The closest of these is King, 17 miles from downtown St. Paul. King is also a possible site for another new unit.

This brief account indicates that the Twin Cities area is a prime candidate for a regional district heating system because of the following attributes:

1. a cold climate and a city structure well adapted to district heating and with a large potential heat load;
2. the present use of fuels that will become increasingly expensive and scarce (natural gas and oil);
3. the existence of coal-fired generating stations near the city with units suitable for conversion to cogeneration;
4. some tradition of district heating and yet not so much that the current steam distribution technology should strongly influence the technology to be used in the future; and
5. interested and cooperative local authorities and utilities with a desire to improve fuel usage and reduce air pollution.

3. SCOPE OF STUDY

Two levels of district heating implementation are discussed: Scenario A, which restricts district heating to the downtown and industrial commercial areas and nearby residential districts, and Scenario B, which also covers medium-density residential districts with one- and two-family houses outside the central parts of the cities. Over a 20-year period, these scenarios are estimated to involve a thermal load of around 2600 and 4000 MW(t), respectively, for the two scenarios (Fig. 2).

The 2600 MW(t) for Scenario A excludes the loads of the existing district heating systems in Minneapolis and at the University of

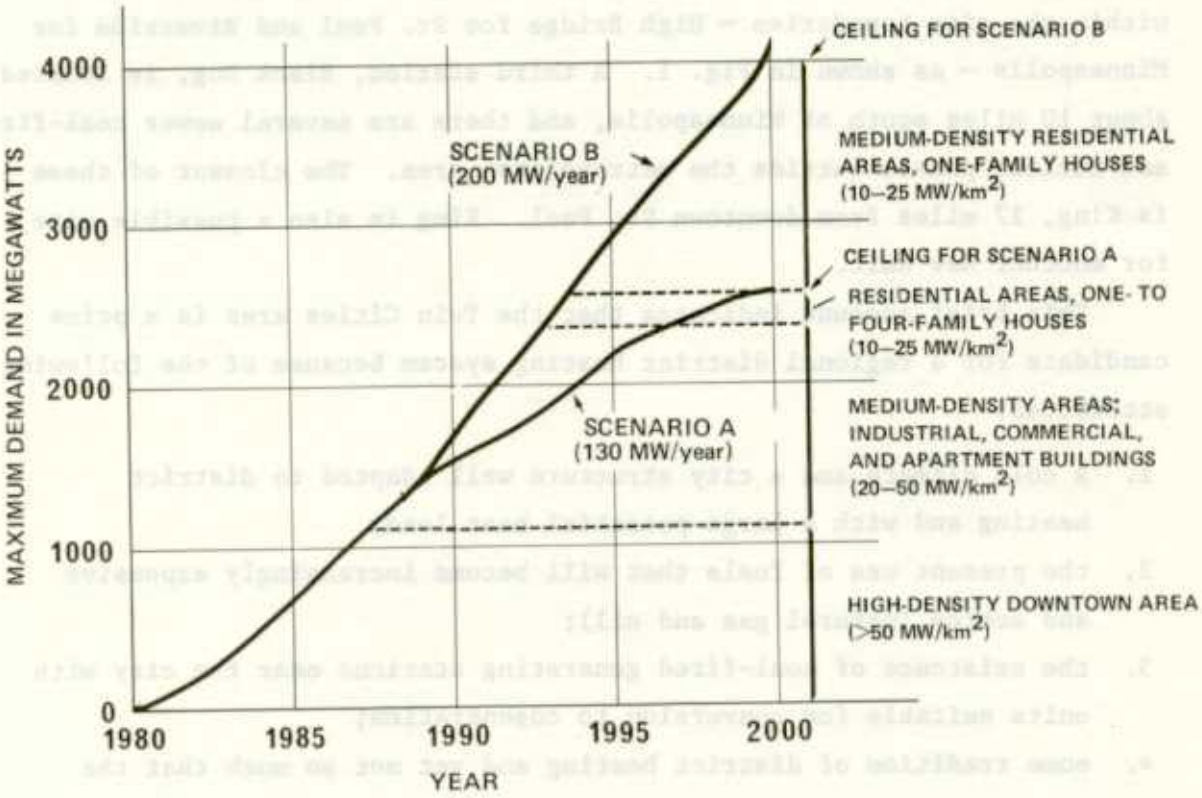

Fig. 2. Assumed load connection rates for Scenarios A and B.

Minnesota because more detailed studies on integration of these schemes into the overall scheme are necessary. It also excludes the loads of some large industries that require more study and all loads for future establishments within the area. To compensate for the conservatism of these assumptions, it was assumed in the base case that all remaining consumers within the area would subscribe to the service. The influence of a lower effective subscription rate was evaluated separately. For Scenario B, 70% of the potential additional consumers over and above those of Scenario A were assumed to use the service.

Although the assumed starting date for the development is 1980, practical questions may delay the date by one or more years. The basic technology assumed is that used in modern Swedish systems, which now supply an increasingly large part of the national demand for space

heating and domestic hot water by hot water distribution systems. About 3 million people in a population of 8 million are now served by district heating at home or at work.

3.1 Principal Features of Proposed Concept

The proposed district heating concept functions as follows:

1. The base load is supplied by cogeneration plants that provide about half the total peak-load capacity but nearly 90% of the annual heat energy (Fig. 3). Most of the thermal energy from cogeneration units is provided by converting turbogenerators to pass-out machines at two existing power stations — Riverside in Minneapolis and High Bridge in St. Paul. As illustrated in Fig. 4, this greatly improves fuel utilization. Toward the end of the period, these units would be complemented by new units. A new unit at Riverside is assumed for Scenario A. For Scenario B, two larger units about 17 miles from the center of the city area are proposed because it seems impracticable to use the city power plants exclusively. The cogeneration plants replace large quantities of oil and gas by small quantities of coal.

2. The peak load and reserve capacity requirements are supplied by oil-fired, heat-only boilers. These have a large total capacity but supply only a small percentage of the annual heat energy. They are located at various points of the supply area, thus reducing the size of pipes necessary between the central cogeneration plant sites and the supply areas.

3. The heat is transported from the production plants to the various parts of the supply area by hot water mains in accordance with modern European district heating technology. Large pipes run through tunnels for the parts of the area having adequate rock structure. Elsewhere underground pipes protected by concrete culverts are used. The transport systems are built up separately in Minneapolis and St. Paul initially and then interconnected during the second half of the period.

4. The heat is distributed from the regional system to individual buildings and houses by a hot water distribution system that runs under pavements, under streets, or, where possible, through cellars.

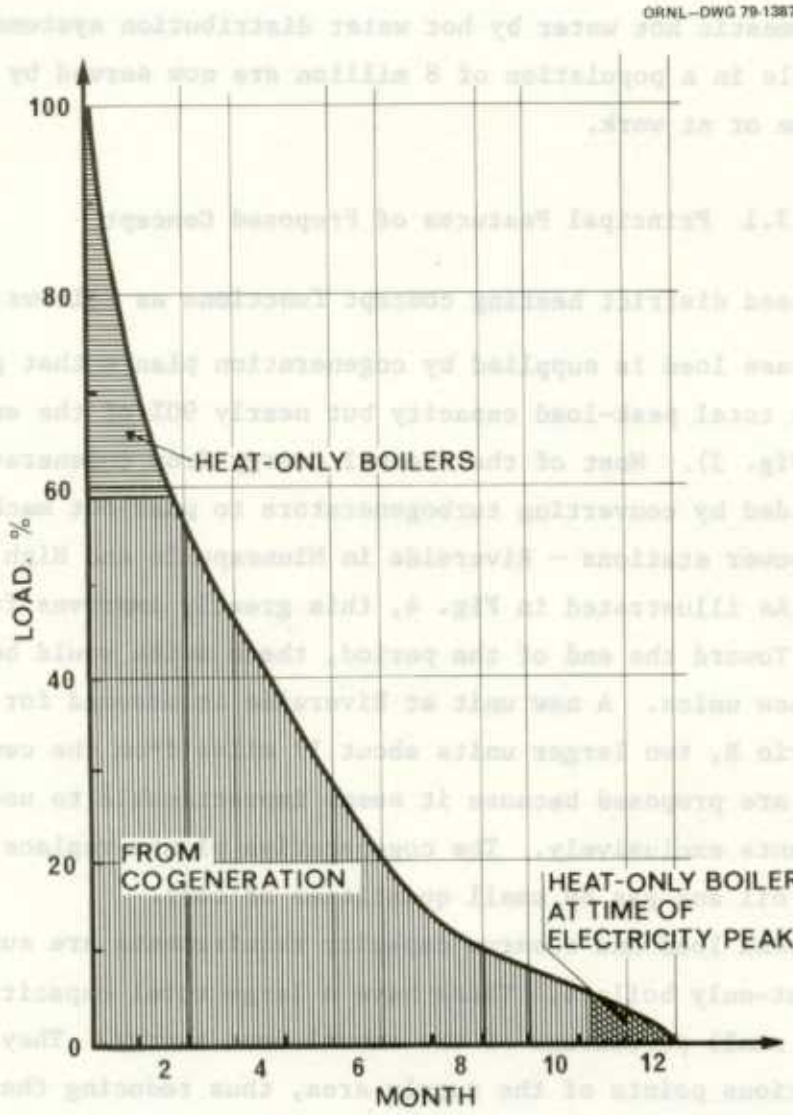

Fig. 3. Heat load duration curve and load distribution.

Prefabricated pipes complete with insulation and protection ducts are used. For Scenario B, in addition to conventional current piping systems, a newer type of piping distribution system for low-heat-density residential areas has been examined.

5. The heating systems of existing buildings are adapted so that they can be connected to the district heating system through heat exchangers. Different conversions are used for buildings and houses currently supplied by hot water, steam, or hot air.

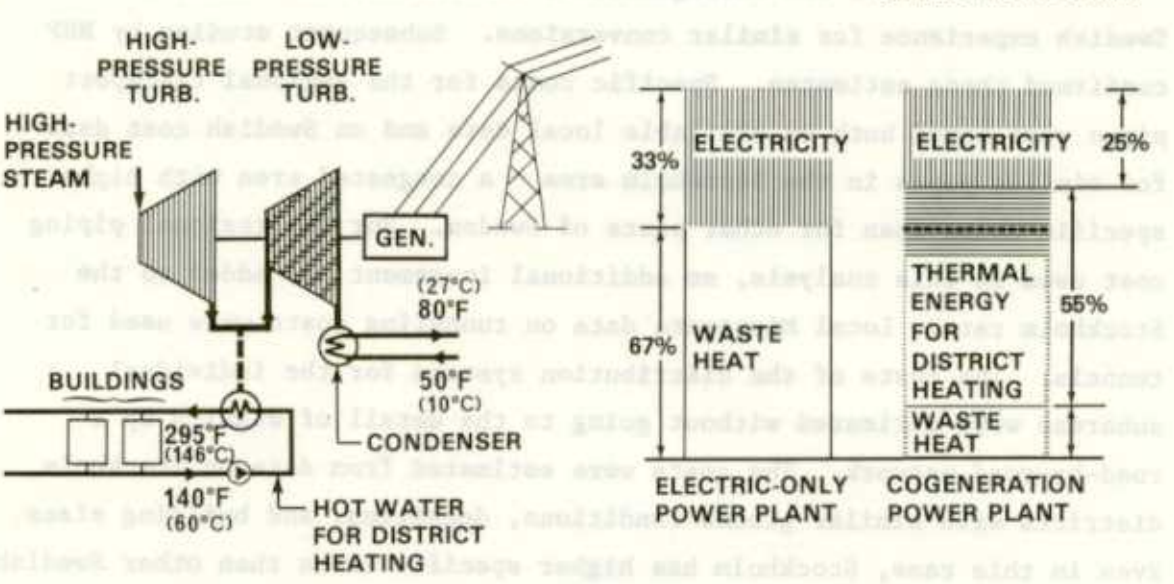

Fig. 4. Comparison of overall thermal efficiency of electric-only and cogeneration power plants.

6. The cooling loads were ignored in the analysis. However, in principle, existing absorption chillers could be converted to operate on hot water and could be supplied from the district heating system if certain restrictions are placed on the lowest permissible temperatures for hot water in the summer. The total capacity of such coolers is presently small, so that the impact on the overall economics would be minimal.

The system is built up progressively, starting with the densest heat load areas so as to start generating maximum revenues as soon as possible. The heat loads of the two existing district heating systems in central Minneapolis as well as the heat loads of some large industries have been ignored because more detailed studies are required before these loads can be integrated into the overall scheme.

3.2 Method for Calculations and Cost Estimates

Heat loads were calculated from data of actual gas consumption in the various subdistricts, corrected for curtailments and other factors.

Investments for the turbogenerator conversions were based on Swedish experience for similar conversions. Subsequent studies by NSP confirmed these estimates. Specific costs for the regional transport pipes were based both on available local data and on Swedish cost data for similar pipes in the Stockholm area — a congested area with higher specific costs than for other parts of Sweden. For the regional piping cost used in this analysis, an additional increment was added to the Stockholm rate. Local Minnesota data on tunneling costs were used for tunnels. The costs of the distribution systems for the individual subareas were estimated without going to the detail of drawing up a road-by-road network. The costs were estimated from data on Stockholm districts with similar ground conditions, densities, and building sizes. Even in this case, Stockholm has higher specific costs than other Swedish cities due to congestion and labor costs.

The regional piping system was designed using a computer program. The impact of the operation of the cogeneration plants on the electricity system was studied by comparing costs for all electric generating units in the NSP utility system without and with cogeneration.

The cost estimate for converting the heating systems of existing buildings for connection to a district heating system of the type proposed was based on a preliminary study carried out by MEA with the help of local consultants and advice from a Swedish consultant.

4. FUEL SAVINGS

The study shows that the district heating system would replace oil and natural gas equivalent to 49 and 61 million barrels of oil for Scenarios A and B, respectively, over the 20-year period studied (Fig. 5). Without district heating, the amount of fuels used for space heating with respect to the areas for Scenarios A and B is 57 and 72 million barrels. After correction for extra coal consumption at the power plants, the net fuel savings are 31 and 39 million barrels of oil, respectively. Thus, very substantial contributions to conservation of fuel — particularly the scarce fuels — are made. It should be pointed out that since the

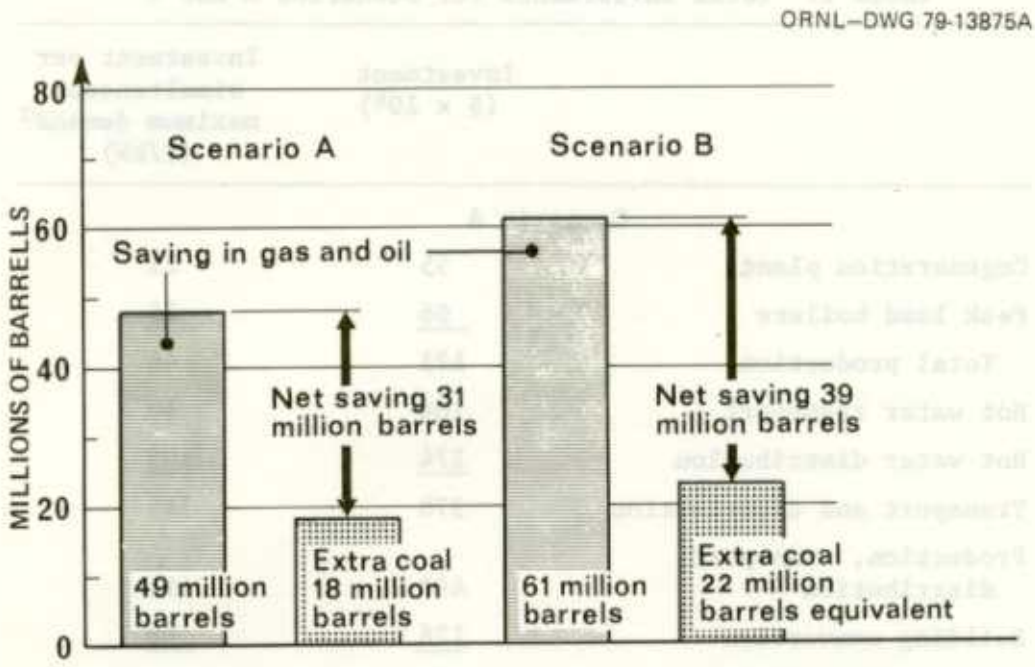

Fig. 5. Fuel savings realized with district heating, 1980-2000, Scenarios A and B.

system is developing from "ground zero" during this 20-year period, the fuel savings in the following years will be even greater. Almost as much fuel will be saved in the subsequent 10 years as in the first 20 years.

5. REQUIRED INVESTMENTS

The total additional investment for the utilities and buildings is estimated at 625 million 1978 dollars for Scenario A. The total investment for Scenario B is $1235 million with conventional distribution technology and $1136 million with newer technology (see Table 1).

6. ECONOMICS

Whereas, in practice, the cost of consumer heat system connections and conversions could be borne by the consumers or the utility (or both), it was assumed in the study that the utility would finance these investments. As a result, the rate charged for heat can be compared directly

Table 1. Total investments for Scenarios A and B

	Investment ($ × 10^6)		Investment per simultaneous maximum demand[a] ($/kW)	
Scenario A				
Cogeneration plants	55		21	
Peak load boilers	66		25	
Total production	121		46	
Hot water transport	104		40	
Hot water distribution	274		105	
Transport and distribution	378		145	
Production, transport, distribution	499		191	
Building conversion	126		48	
Grand total	625		239	
Scenario B				
Cogeneration plants	98		24	
Peak load boilers	114		28	
Total production	212		52	
Hot water transport	221		54	
Hot water distribution	601	502[b]	149	124[b]
Transport and distribution	822	723	203	178
Production, transport, distribution	1034	935	255	230
Building conversion	201	201	50	50
Grand total	1235	1136	305	280

[a] 2621 MW, Scenario A; 4042 MW, Scenario B.

[b] New technology.

with the value of the fuel replaced by the elimination of individual boilers. The rate was set 10% below the cost of the fuel consumed by the cheapest alternative using individual boilers. Capital and operation and maintenance costs of individual boilers were not included in determining the cost of heat of the district heating alternatives.

The cheapest fuel, natural gas or oil, was used to assess these alternative costs, based on fuel price projections prepared by the utility (NSP). Initially the cheapest fuel is gas, but from the mid-1980s on it is oil. Swedish experience is that most consumers prefer district heating even if the cost is higher than that for alternative supplies because of the greater convenience.

If the cost of consumer system connections and conversions is borne by the consumers, the utility can offer a lower rate for the heat. This gives the consumer an additional saving that can be used to pay the capital charges on the investments.

The difference between the utility's income from sales of heat and the utility's annual operating costs and capital charges (including taxes) has been termed the "net saving."

6.1 Inflation and Fuel Costs

For the base cases, predictions by NSP on future inflation rates and development trends for fuel costs were used. These represent an inflation rate of 5 to 6%/year at the beginning of the period which will decrease to 4%/year by the year 2000. The cost projections are illustrated in Fig. 6. The inflation factor is applied in calculating investments and fuel costs in current dollars.

Coal costs are assumed to increase by about 1.3%/year in terms of 1978 dollars throughout the period. Electricity costs for auxiliaries such as pumps also increase only slightly in terms of 1978 dollars because the influence of some fuel price increases is counteracted by cost reductions due to the growth of the overall system.

Oil costs are assumed to reach world market prices of $16 per barrel of building heating oil by 1981* and to increase thereafter at about 2%/year

*Significant increases in world market prices have occurred since the beginning of the study.

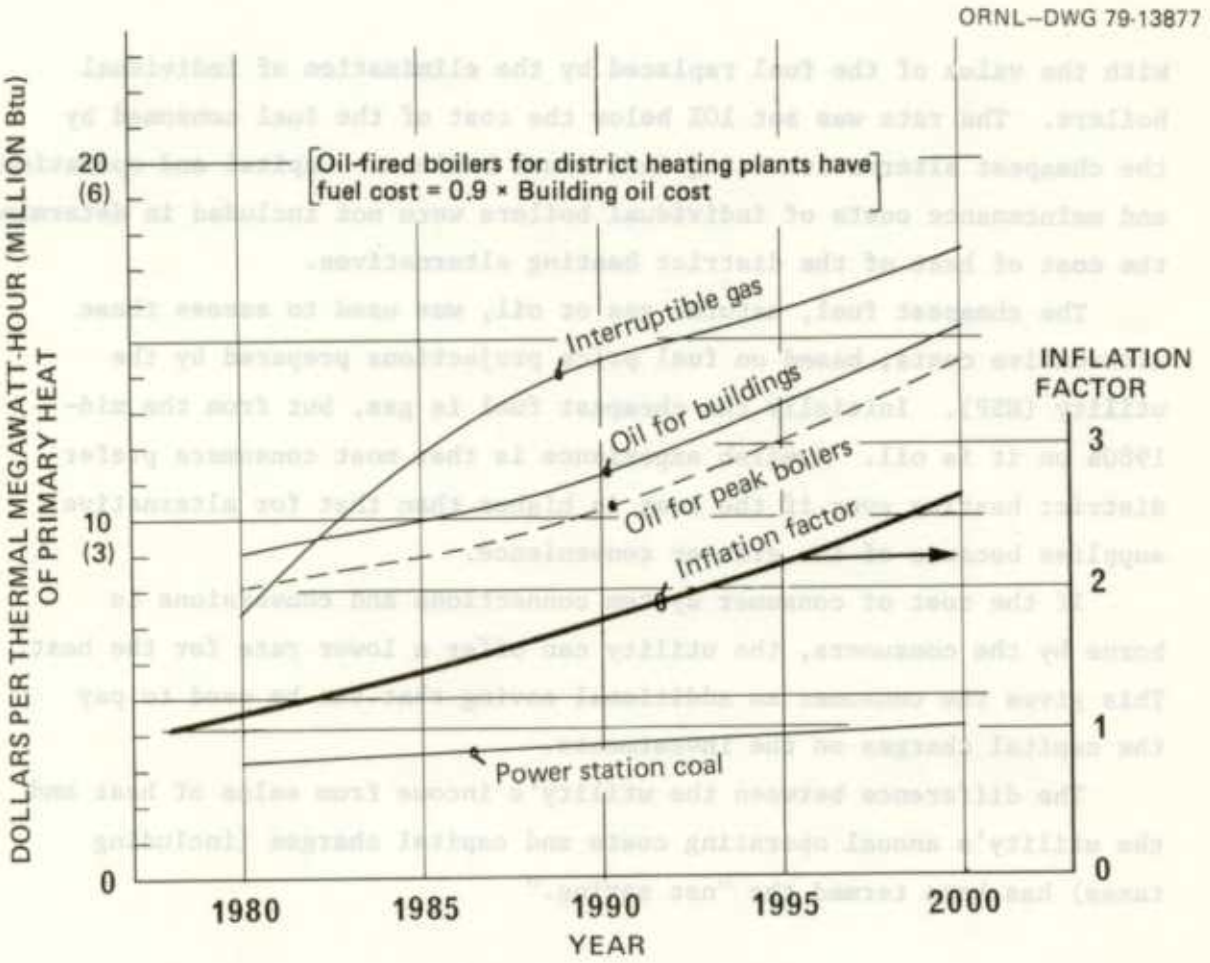

Fig. 6. Assumed costs of primary fuels over the period 1980–2000 in 1978 dollars (higher calorific value of fuel).

in terms of 1978 dollars (i.e., slightly more rapidly than inflation). The mean individual boiler efficiency is 70%, and efficiency for large heat-only district heating boilers is 90%. The additional residential load for Scenario B is assumed to have a mean individual boiler efficiency of 58%.

Gas prices are assumed to increase by a factor of 2.4 over the 20-year period. By the mid-1980s the gas prices to consumers begin to exceed those for light oil (houses) and medium-grade oil (buildings). The NSP estimators state that their oil price projections are on the low side for the long-term view. To compensate for this, an alternative case has been covered by the calculations in which gas and oil prices increase by an additional 1%/year.

6.2 Capital Charges

The capital charges (Table 2) for the district heating utility have been calculated on two bases: (1) with municipal utility financing and (2) with private utility financing including taxes.

Table 2. Capital charges and book depreciation periods[a]

Base	Capital (%)		Capital charges (%)		
	Debt	Equity	Interest on debt	Interest on equity	Tax
Private utility	50	50	8.4	13.36	51.95
Municipal utility	100		6.5		

[a]Book depreciation periods (years): transport and distribution lines (35), new cogeneration plants (30), conversion of existing turbines (20), heat-only boilers (25), consumer substations (15).

6.3 Results

The economic calculations for Scenario A and municipal financing show that the net savings are negative in the initial years but soon become positive (see Fig. 7). Over the entire period, there is an accumulated present worth net saving equivalent to 183 million 1978 dollars (Fig. 8).* With private utility financing, capital charges are higher and the accumulated present worth net saving therefore becomes negative — $77 million over the period studied. The sensitivity of the result to changes in assumptions (e.g., fuel cost projections) is also illustrated. With an intermediate financing system — private utility for the production plant and municipal financing for piping systems — the net accumulated savings would be about $132 million.

For Scenario B, municipal financing gives accumulated net annual savings of $238 million and $274 million for conventional and for newer distribution technology in the outer residential areas,

*All monetary figures in this section are in terms of 1978 dollars.

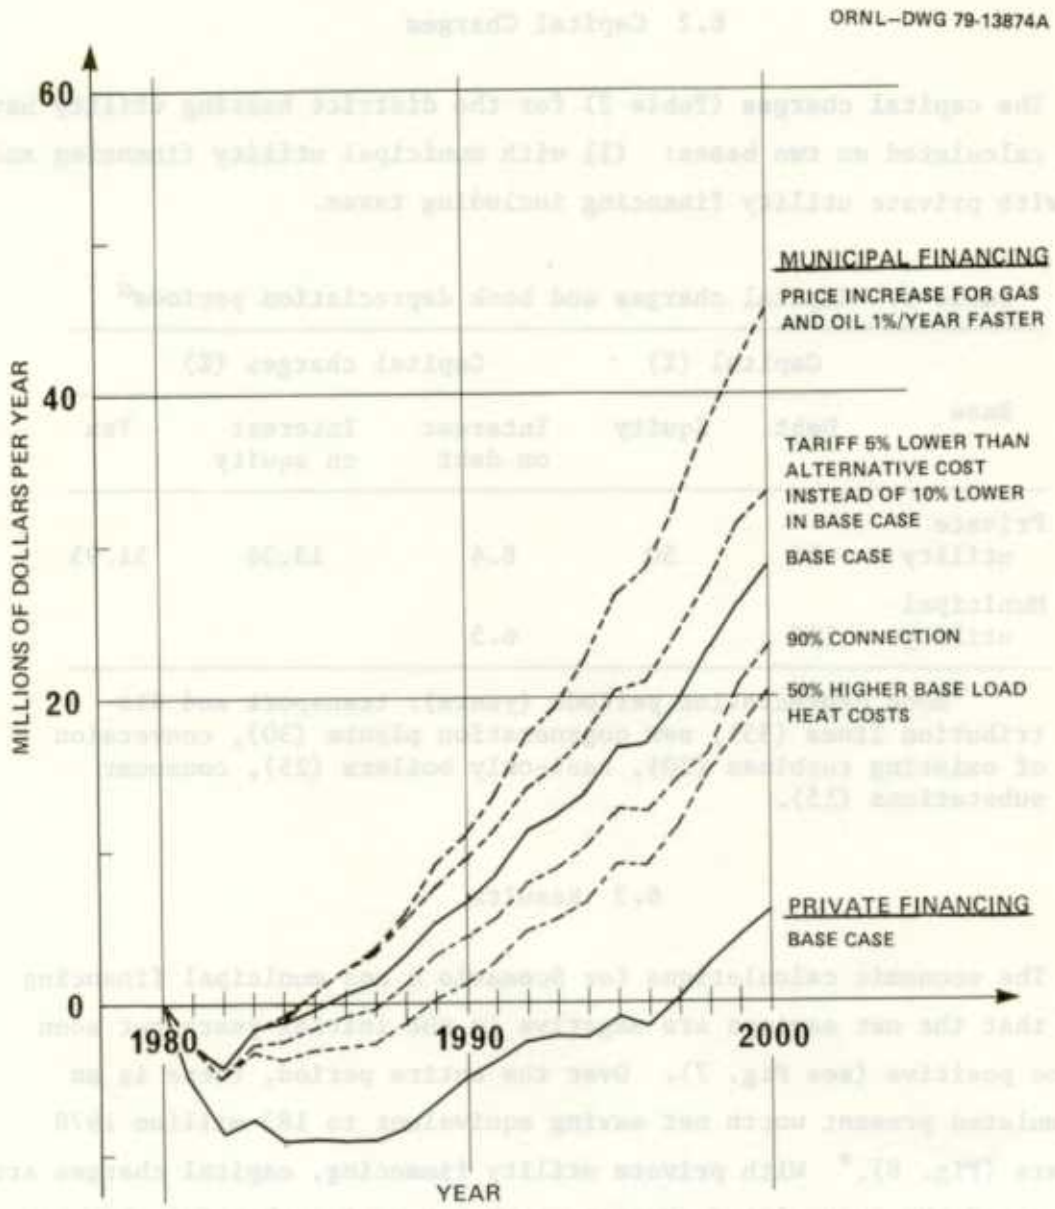

Fig. 7. Annual net savings in 1978 dollars, Scenario A.

respectively (Fig. 9). The savings are -$151 million and -$118 million for private utility financing and +$171 million and +$201 million for the intermediate case of private utility financing for production plants and municipal utility financing for distribution systems. Any significant positive net savings could be used to lower the rate charged for heat, thereby making the district heating system even more attractive to the customer when compared with the oil and gas alternative.

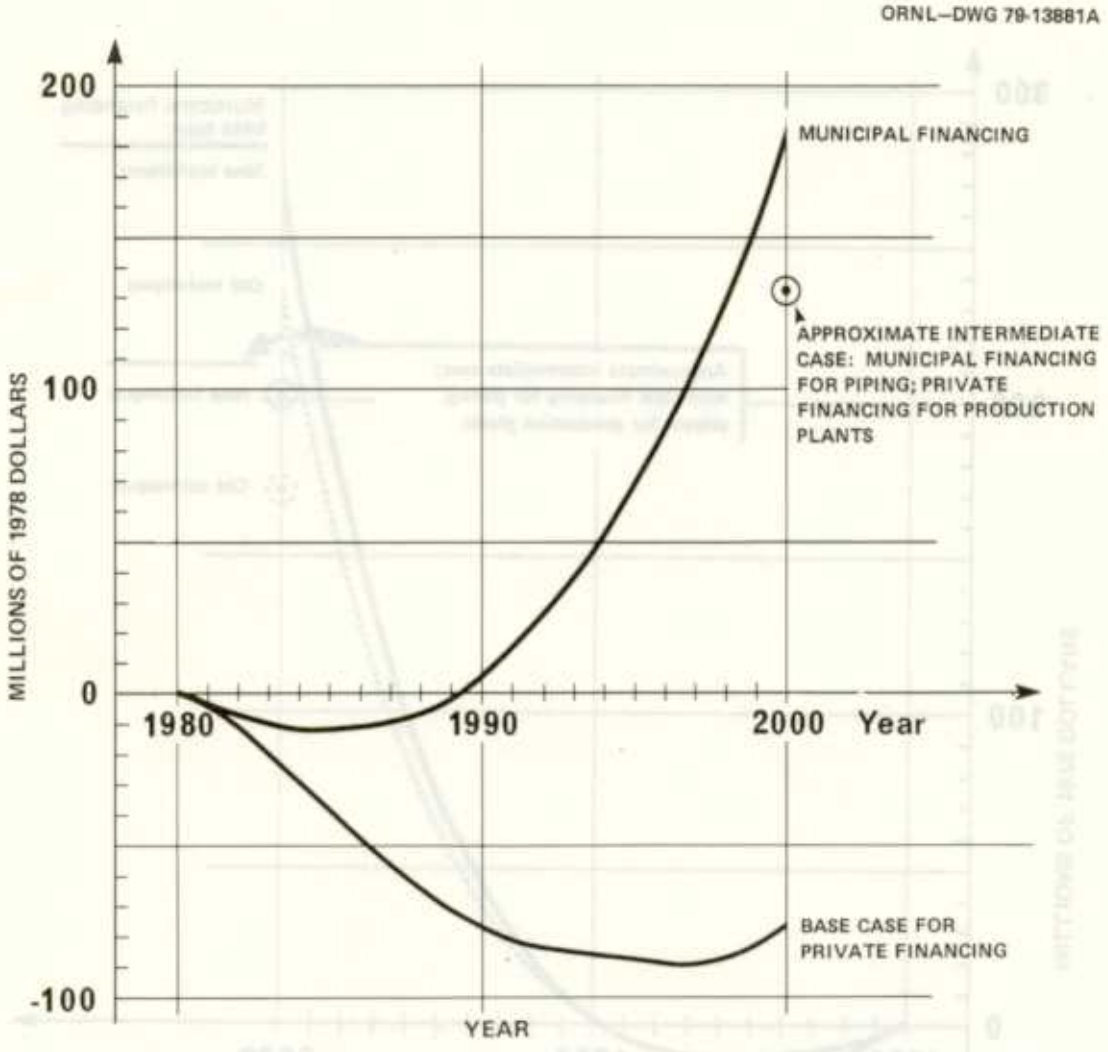

Fig. 8. Accumulated present worth of net savings for base case, Scenario A.

6.4 Sensitivity to Variations in Assumptions

The influence of different assumptions in the economic calculations has been evaluated (Table 3). For example, it is assumed that piping costs have been evaluated conservatively compared with the costs that would result if European experience were fully utilized. A 20% reduction in this cost would increase the accumulated net saving by about $44 million, and a 1%/year faster rise in fuel costs would increase the accumulated net savings by $125 million.

ORNL–DWG 79-13873

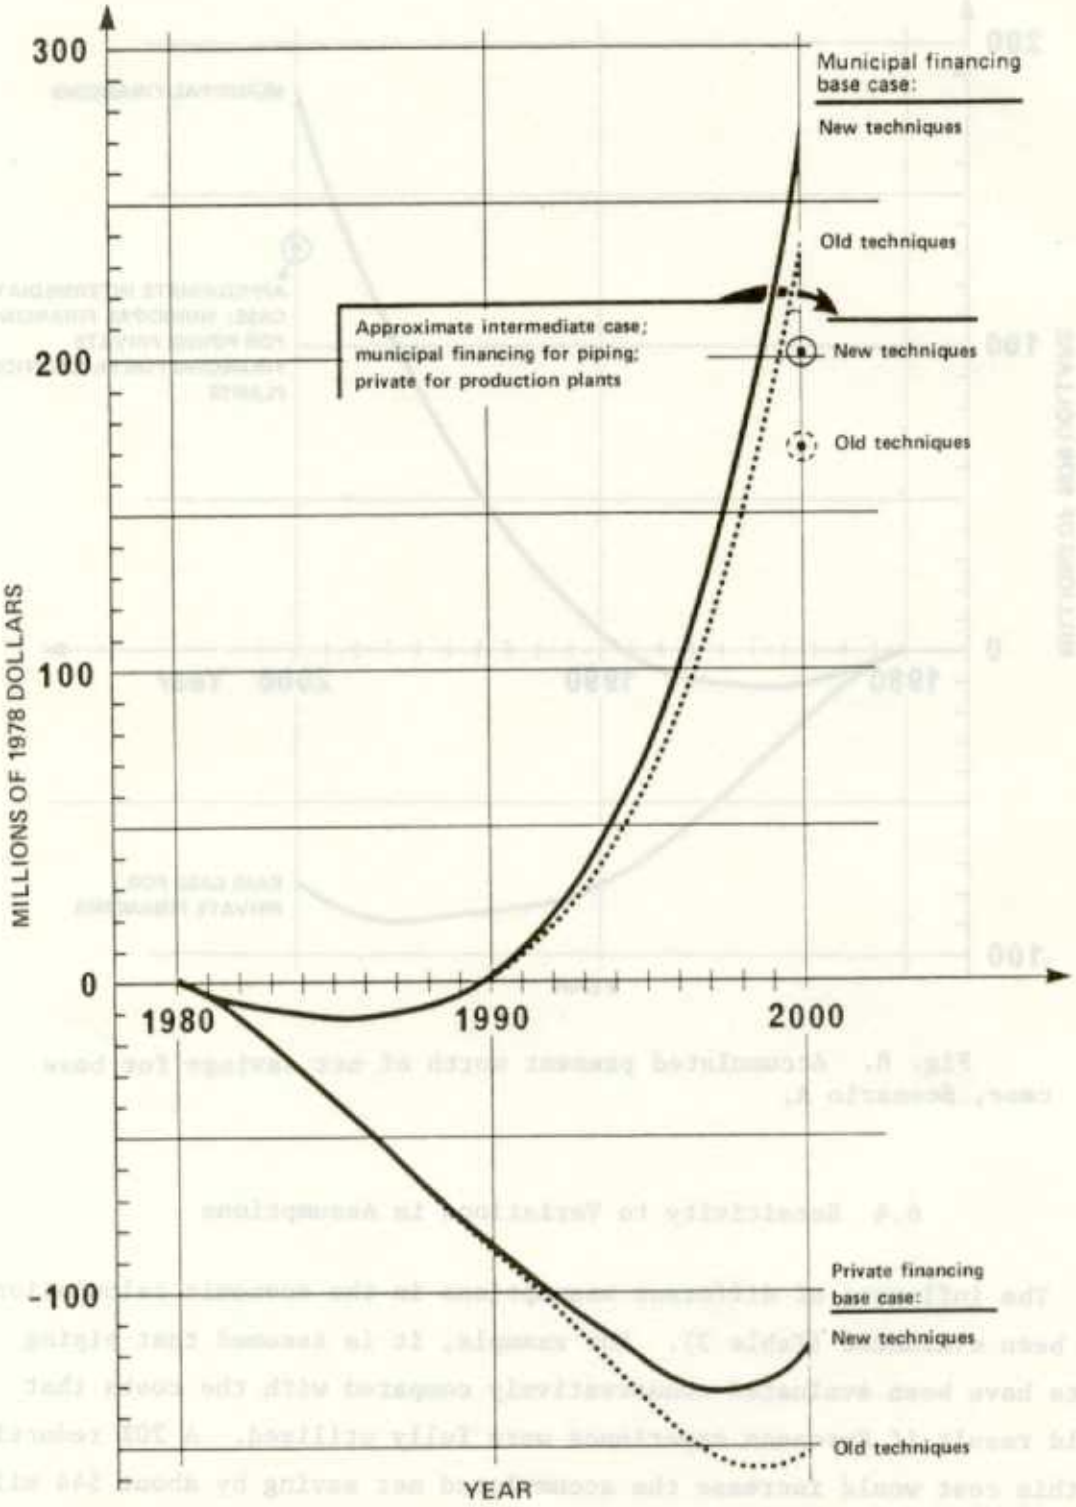

Fig. 9. Accumulated present worth of net savings for Scenario B.

Table 3. Sensitivity of net accumulated savings (millions of 1978 dollars) to changes in assumption, Scenario A

	Net accumulated saving		Change from base case	
	Municipal finance	Private utility finance	Municipal finance	Private utility finance
Base case	182.8	-76.5		
20% lower transmission and distribution costs	227.2	-32.5	+44.4	+44.0
90% connection without change in transmission and distribution costs[a]	127.2	-103.1	-55.6	-26.6
50% of building conversion costs charged to district heating system (instead of 60%)	189.6	-62.2	+6.8	+14.3
1%/year faster oil and gas cost increases	308.1	-13.7	+125.3	+62.8
50% higher base-load energy costs (coal)	81.3	-131.8	-101.5	-55.3
District heating rate at 5% below alternative fuel cost (instead of 10%)	234.3	-48.7	+51.5	+27.8
Includes the effect of property taxes (4.5% for the private utility finance)		-133.3		-56.8
Extends the economic analysis another 10 years for a total of 30 years	501.0	11.88	+318.2	+88.4

[a]Pessimistic assumption because transmission and distribution systems would be cheaper with 90% connection.

One of the potential benefits excluded in the analysis is the influence of a deferment of investments. This could be realized by connecting the low-pressure part of the existing steam district heating system in St. Paul to a hot water system via a heat exchanger producing low-pressure steam and then converting the system to water as the existing system becomes obsolete.

The variations in assumptions produce increases or reductions in the calculated accumulated net savings compared with the base cases. However, the base cases are assumed to represent a reasonable assessment with some conservatism of what really can be achieved (Table 4).

Table 4. Simplified assumptions that tend to give conservative (+) or optimistic (-) results compared with expectations, Scenario A

Assumption	Conservative assumptions	Optimistic assumptions
Heat-only boilers		
Neglect to use existing boilers at 3rd Street plant in St. Paul, at larger industries, and in larger buildings	+	
Assumption that sites can be found for new oil-fired boilers at all major line junctions		-
Heat storage		
Neglect of use of heat accumulators to cut daily load peaks and improve flexibility of cogeneration plants	+	
Existing low-pressure steam system		
Neglect to connect St. Paul 8-psi steam system load (about 40 MW) by heat exchanger to delay conversion and new mains	+	

More detailed studies are under way for the cost of converting the existing turbogenerators, for pipe design and cost estimates related to specified districts, and for building conversions that will allow the economic calculations to be refined successively during 1979.

7. ENVIRONMENT

Environmental effects are being studied separately, but some general observations may be made.

Experience from Swedish cities using mainly oil for heating indicates that district heating greatly improves air quality, particularly sulfur dioxide, at street levels. This improvement is partly due to elimination of low-level emissions and partly due to more complete combustion. In some cases, sulfur dioxide content at street level has been reduced by an order of magnitude. According to the assumptions made in the economic analysis for this study, without district heating, individual buildings would use the cheapest fuel available, which would be oil from the mid-1980s on. If the actual practice is in accordance with this assumption, a major increase in air pollution will occur in the Twin Cities area. However, district heating would restrict this pollution to limited amounts from high power station stacks, thus greatly improving air quality. If gas is used extensively for individual heating, even after the mid-1980s, the impact of district heating on air quality would be reduced, but the economics of district heating would be improved because gas prices are projected to be higher than oil prices.

8. INSTITUTIONAL ISSUES

Institutional issues are also being addressed separately. The present report emphasizes the importance of defining ownership at an early date, establishing favorable financing methods, at least for the piping systems, and the following:

1. clarifying at an early date permission to continue operation of converted cogeneration plants, bearing in mind the net beneficial effects on environment despite continued emission from these plants;
2. arranging forms of reasonably long-term loans for consumer connection and conversion investments; and
3. devising a rate structure for the sale of heat and other incentives to ensure that practically all consumers will connect to a distribution line once it is available (state and federal measures could help fulfill this goal).

9. CONCLUSIONS

The overall conclusion of the study is that district heating on a regional basis in the Twin Cities area is technically feasible, that large quantities of the potentially scarce and expensive fuels (natural gas and oil) can be saved, and that air quality can be improved. The economics are judged to be viable provided a suitable method of financing is used for the transmission and distribution systems.

The study should be complemented by more detailed engineering designs before the scheme can be implemented.

Much of the information and the methodology used is applicable also to other cities in the United States, though individual studies are necessary to establish the economics in each case.

ORNL/TM-6830/P2
Dist. Category UC-95d

INTERNAL DISTRIBUTION

1. R. W. Barnes
2. S. E. Beall
3. H. Bowers
4. B. H. Bronfman
5-24. B. Brummitt
25. R. S. Carlsmith
26. J. E. Christian
27. T. E. Cole
28. J. G. Delene
29. R. C. DeVault
30. P. D. Fairchild
31. W. Fulkerson
32. R. L. Graves
33-82. M. A. Karnitz
83. O. Klepper
84. J. O. Kolb
85. F. Kornegay
86. C. G. Lawson
87. H. A. McLain
88 J. T. Meador
89. M. E. Merhoff
90. J. W. Michel
91. W. R. Mixon
92. B. D. Murphy
93. M. Olszewski
94. G. D. Pine
95. R. J. Raridon
96. R. C. Riepe
97. T. H. Row
98. E. C. Schlratter
99. D. Scott
100. I. Spiewak
101. W. G. Stockdale
102. J. S. Tatum
103. H. E. Trammell
104. J. M. Vance
105. T. J. Wilbanks
106. D. J. Wilkes
107-108. (2) Central Research Library
109. (1) Document Reference Section
110-111. (2) Energy Information Library
112. (1) Laboratory Records (RC)
113. Laboratory Records Dept.
114. ORNL Patent Office

EXTERNAL DISTRIBUTION

115. Conrad Aas, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

116. Delbert Anderson, Minnesota House of Representatives 1980, State Office Building, St. Paul, Minnesota 55155.

117. Jane Anderson, 19200 Cedarhurst, Wayzata, Minnesota 55391.

118. Jack Angland, Northern States Power, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

119. M. Todd Anuskiewicz, Michigan Energy & Resource Res. Assoc., 1200 Sixth Street, Room 328, Detroit, Michigan 48226.

120. Gary C. Ashley, 3960 Woodridge Circle, St. Paul, Minnesota 55110.

121. Eugene Avery, Public Service Department, American Center Building, St. Paul, MN 55101.

122. Mike Barnes, KVB, Inc., 6176 Olson Memorial Highway, Minneapolis, Minnesota 55422.

123. A. G. Barnstaple, 700 University Avenue, Toronto, Ontario M5MIC9.

124. William Bethea, Department of Energy, 20 Massachusetts Avenue, Washington, D.C. 20545.

125. Stephan Bernow, Energy Systems Research Group, 120 Milk Street, Boston, Massachusetts 02109.

126. Garet Bornstein, Department of Energy, Mail Stop 461, Washington, D.C. 20461.

127. Joseph J. Bosl, Cleveland Electric Illuminating Co., 55 Public Square, Cleveland, OH 44114.

128. Robert F. Botsford, Rochester Gas & Electric, 89 East Avenue, Rochester, New York 14649.

129. Art Boll, Touche Ross & Company, 780 North Star Center, Minneapolis, Minnesota 55417.

130. Craig Bradley, United Illuminating, 80 Temple Street, New Haven, Connecticut 06506.

131. Don Brandt, D. H. Brandt Associates, 10101 Snow Road, Horton, Michigan 49246.

132. Ed Browning, Consumers Power Company, 1945 W. Parnall Road, Jackson, Mississippi 49201.

133. Alfred Bruhn, 470 Park Avenue, S, New York, New York 10016.

134. Clark Bullard, Department of Energy, Bldg-FED, Washington, D.C. 20545.

135. Edward Burgher, 802 Seventh Street, S, Virginia, Minnesota 55792.

136. George Burton, Mount Sinai Hospital, 2215 Park Avenue, Minneapolis, Minnesota 55427.

137. William Buth, Building Owners & Managers Association, Northern Federal Building, St. Paul, MN 55102.

138. Fred R. Callowhill, Gilbert/Commonwealth Company, P. O. Box 8, Quechee, Vermont 05059.

139. James M. Calm, Argonne National Laboratory, Energy & Environmental Systems Division, 9700 South Cass Avenue, Argonne, Illinois 60439.

140. F. R. Carpentier, 100 Summer Street, Boston, Massachusetts 02110.

141. Fred W. Carson, McMaster University, 1280 Main Street, Hamilton, Ontario Canada L8S 4M3.

142. James E. Carter, 118 Belvidere, Forest Park, Illinois 60130.

143. Steve Cavros, Department of Energy, Mail Stop 2221C, 20 Massachusetts Avenue, NW, Washington, D.C. 20545.

144. John Chenoweth, Minnesota Senate, State Capitol, St. Paul, MN 55155.

145. N. B. Childress, Wisconsin Electric Company, 231 W. Michigan, Milwaukee, Wisconsin 53201.

146. F. W. Childs (UPD, T3),EG 8G Idaho, P. O. Box 1625, Idaho Falls, ID 83401.

147. W. R. Chopp, G. Rose Garden Court, Lathan, NY 12110.

148. Calvin W. Clark, Citizens League, Minneapolis, MN 55101.

149. Ellwood A. Clymer, Philadelphia Electric Company, 2301 Market Street, Philadelphia, PA 19101.

150. G. W. Conkright, 7720 Lehigh Avenue, Niles, Illinois 60648.

151. Edward Cook, 410 South Third Street, Box 12, River Falls, Wisconsin 54022.

152. Robert O. Couch, Ric-Wil, Inc., 10100 Brecksville Road, Brecksville, OH 44141.

153. Gloria Cousar, Department of Housing & Urban Development, Room 7204, Washington, D.C. 20410.

154. R. L. Cowles, Department of Energy, Mail Stop 2221C, 20 Massachusetts Avenue, Washington, D.C. 20545.

155. Dick Cramer, 5916 Pleasant Avenue, Minneapolis, MN 55419.

156. John Crawford, Department of Energy, Mail Stop B-107, BLDG-GTN, Washington, D.C. 20545.

157. Jess Cristobal, Honeywell Plaza, Minneapolis, Minnesota 55408.

158. C. W. Crooks, Baltimore Gas & Electric Gas Supply Department, Fort Avenue and Leadenhall Street, Baltimore, MD 21203.

159. Lars-Ake Cronholm, Studsvik Energiteknik AB, S-611 82, Nykoping, SWEDEN.

160. Gene Culver, Associated Director, Geo-Heat Utilization Center, Oregon Institute of Technology, Klamath Falls, Oregon 97601.

161. C. C. Cutley, Pennsylvania Power & Light Company, 2 North Nineth Street, Allentown, Pennsylvania 18101.

162. Frank J. Czysz, 2 North Nineth Street, Allentown, PA 18101.

163. Howard C. Daudet, Airesearch Manufacturing Company, 111 South 34th Street, Phoenix, Arizona 85034.

164. William J. Deeham, Environment & Energy Section, Office of Environmental Planning, NYS Department of Public Service, Empire State Plaza, Agency Building 3, Albany, NY 12223.

165. James B. Delano, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

166. Peter A. Dewitt, 1011 South Eighth Street, Sheboygon, Wisconsin 53081.

167. Peter Donnelly, Argonne National Laboratory, 9700 South Cass Avenue, Argonne, Illinois 60439.

168. Maurice Dorton, Metropolitan Council, 300 Metro Square Building, Seventh and Robert, St. Paul, MN 55101.

169. Kenneth F. Dowell, 10360 Columbus Circle, Bloomington, MN 55420.

170. P. R. Dwyer, Detroit Edison, 2000 Second Street, Detroit, Michigan 48226.

171. C. W. Easton, 3515 Rainier Bank Tower, Seattle, Washington 98101.

172. Bob Edeskuty, 730 Second Avenue, S, Suite 835, Minneapolis, MN 55402.

173. William W. Eldridge, 1518 Chestnut Avenue, Minneapolis, Minnesota 55403.

174. George Englesson, United Engineers & Constructors, 30 South 17 Street, Philadelphia, Pennsylvania 19101.

175. Robert Fergusen, Department of Energy, Mail Stop B-107, BLDG-GTN, Washington, D.C. 20545.

176. Floyd Forsberg, Project Director, Twin Resco, 234 City Hall, St. Paul, Minnesota 55102.

177. Ward Foss, 1080 Montreal Avenue, St. Paul, MN 55116.

178. Andrew L. Foster, C. T. Main, Inc., Southeast Tower, Prudential Center, Boston, Massachusetts 02199.

179. Donald R. Franzmann, 100 North Barstow Street, Eau Claire, Wisconsin 54701.

180. P. E. Fuller, Pfeifer & Shultz HDR, Inc., 5401 Gamble Drive, Minneapolis, Minnesota 55416.

181. Rudolph J. Gallina, Baltimore Gas & Electric Company, 1508 Woodlawn Drive Livingston, NJ 07039.

182. Jim Galt, Reynolds, Smith & Hills, P. O. Box 4850, Jacksonville, Florida 32201.

183. Howard S. Geller, School of Engineering, The Engineering Quadrangle, Princeton, New Jersey 08540.

184. R. M. Gerzetich, Consumer Power Company, 212 W. Michigan Avenue, Jackson, Michigan 49201.

185. John Gilbert, Department of Energy, BLDG-FORSTL, Washington, D.C. 20545.

186. W. M. Gillespie, Dayton Power & Light Company, Courthouse Square, SW, Dayton, Ohio 45401.

187. Robert Gish, No. 980, 150 E. Kellogg Blvd., St. Paul, Minnesota 55101.

188. Ed Glass, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

189. Bruce Glassford, Modern Power & Engineering, 481 University Avenue, Toronto, Ontario Canada MSW1A7.

190. Jack Gleason, Earth Resource Research, 2641 Garfield Street, NW, Washington, D.C. 20008.

191. Professor Leaon R. Glicksman, MIT 3-137, 77 Massachusetts Avenue, Cambridge, Massachusetts 02139.

192. Max Goldbert, City of Minneapolis, Minneapolis, Minnesota 55415.

193. Neal Goldenberg, Department of Energy, Mail Stop B-107, BLDG-GTN, Washington, D.C. 20545.

194. Ron Griffith, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

195. Janet F. Gonzalez, 160 S. Kellogg Boulevard, St. Paul, MN 55101.

196. Duane Grier, Moorhead State University, 923 Sixth Avenue South, Moorhead, Minnesota 56560.

197. Charles Grua, Environmental Control Technology, Mail Stop E-201, Department of Energy, Washington, D.C. 20545.

198. Ken Hagstrom, Touche Ross & Company, 780 North Star Center, Minneapolis, Minnesota 55402.

199. Frank Hanley, Northstar Division TPCO, 930 Shokie Highway, Lake Bluff, Illinois 60044.

200. William C. Hanselman, Hanselman-Eskow & Associates, 6054 Deerfield Street, Dayton, Ohio 45414.

201. Erwin G. Hansen, Syska & Hennessy, Inc., 110 West 50th Street, New York, New York 10020.

202. John L. Hanson, 3222 Snelling Avenue, Minneapolis, MN 55406.

203. Harvey Happ, Manager of Advanced System Technology, Building 4 Room 210, Electric Utility System Engineering Department, 1 River Road, Schenectady, New York 12345.

204. Noel D. Hazzard, Combustion Engineering, Inc., 1000 Prospect Hill Road, Windsor, CT 06095.

205. Wesley Hellen, Wisconsin Electric Power Company, 231 W. Michigan, Milwaukee, Wisconsin 53201.

206. Burnell Hendrikson, 706 18th Street, SE, Austin, Minnesota 55912.

207. Gerald Hill, Director of Technology Program, One Exchange Place, Suite 1230 Atlanta, Georgia 30338.

208. Neil B. Hilsen, Systems Engineering Division, Engineering Experiment Station, Georgia Institute of Technology, Atlanta, Georgia 30332.

209. Howard Hirsch, 3316 W 66th Street, Minneapolis, Minnesota 55435.

210. Gene Holzer, Engineered Sales Company, 311 West 44th Street, Minneapolis, Minnesota 55409.

211. Randy Hoskin, Rocket Research, 11441 Willows Road, Redmond, WA 98052.

212. Herbert Jaehne, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

213. Algernon Johnson, Minnesota Energy Agency, American Center Building, St. Paul, MN 55102.

214. Peter A. Johnson, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

215. Randall E. Johnson, 2400 Government Center, Minneapolis, Minnesota 55487.

216. Peter Jones, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

217. Anssi Kalmari, Ekono, Inc., 410 Bellevue Way, SE, Bellevue, Washington 98004.

218. John Kari, Metro Council, St. Paul, MN 55101.

219. J. Karkheck, Brookhaven National Laboratory, Upton, New York 11973.

220. Jack Katlner, HDR, 5401 Garmble Drive, Minneapolis, MN 55416.

221. James J. Kavaloski, Suite 316 Courthouse, St. Paul, MN 55102.

222. Carey Kinney, Department of Energy, Mail Stop E178, Bldg-GTN, Washington, D.C. 20545.

223. Kaarlo Kirvela, Ekono OY, PL27, SF-00131, Helsinki, FINLAND.

224. Richard Klink, PERMA-PIPE Division, Midwesco, Inc., 7720 N. Lehigh Avenue, Niles, Illinois 60648.

225. Paul Klisiewicz, Charles T. Main, Inc., Southeast Tower, Prudential Center, Boston, Massachusetts 02199.

226. Tom Kosvic, KVB, Inc., 6176 Olson Memorial Highway, Minneapolis, MN 55422.

227. Edward Kozan, 813 Fifth Street, Virginia, MN 55792.

228. Richard E. Kremer, Hennepin County, 2400A Government Center, Minneapolis, Minnesota 55487.

229. Jane Ladky, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

230. James P. Lagowski, Detroit Edison, 2000 Second Avenue, Detroit, Michigan 48226.

231. William F. Laidlaw, Northern States Power Company, 825 Rice Street, St. Paul, Minnesota 55117.

232. Clarence Lamers, Wisconsin Public Service Company, P. O. Box 7000, Green Bay, Wisconsin 54305.

233. Fred F. Lange, ASHRAE-Minneapolis, Engineer, 1500 E. 79th Street, Minneapolis, Minnesota 55420.

234. Kaleri Lappa, Ekono, Inc., 410 Bellerue Way, SE, Bellerue, Washington 98007.

235. Kjell Larssan, Studsvik Energiteknik AB, S-611 82, Nykoping, Sweden.

236. Ronald E. Larson, Public Service Company of Colorodo, 11 Rainbow Crest Drive, Golden, Colorodo 80401.

237. Mayor George Latimer, 347 City Hall, St. Paul, MN 55102.

238. Robert Lawton, Subcommittee Energy & Power, Room 3204, House Office Building Annex, Washington, D.C. 20515.

239. Peter Lazare, Department of Public Service, 1863 Iglehart Avenue, St. Paul, Minnesota 55104.

240. Rod Leas, 775 Osceola, St. Paul, MN 55113.

241. C. C. Lee, Environmental Protection Agency, 5555 Ridge Avenue, Cincinnati, Ohio 45268.

242. Gerald Leighton,Department of Energy, BLDG-20 Mass, Washington, D.C. 20545.

243. Erv Lentz, Gluidyne Engineering Corporation, 5900 Olson Memorial Highway, Minneapolis, MN 55422.

244. Kalevi Leppa, Ekono, Inc. 410 Bellevue Way, SE, Bellevue, WA 98004.

245. T. Lindahz, Swedish Trade Office, 333 N. Michigan, Chicago, Illinois 60601.

246. Ken Linwick, Minnegasco Energy Center, Inc., 733 Marquette Avenue, Minneapolis, MN 55402.

247. Eric Lister, Department of Energy, Mail Stop E-178, BLDG-GTN, Washington, D.C. 20545.

248. Kenneth P. Lue Phang, Tennessee Valley Authority, Liberty Building, Knoxville, TN 37902.

249. Raymond H. Lund, Electric System Planning Department, Baltimore Gas & Electric Company, 1220 Gas & Electric Building, Baltimore, MD 21203.

250. Gordon Lundskow, Methodist Hospital, Division of Plant Service, Rochester, MN 55901.

251. W. L. Lundy, Bagley Industrial Division Comm., Route No. 1, Box 14A, Bagley, MN 56621.

252. Tom McCauley, City of Moorhead, 1212 23rd Avenue, South, Moorhead, Minnesota 56560.

253. C. L. McDonald, Battelle Pacific Northwest Laboratory, P. O. Box 999, Richland, Washington 99352.

254. John D. McVay, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

255. F. Mach, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

256. Rainer Makirinne, Department of Public Utilities, 220 Third Street South, Virginia, MN 55792.

257. Richard L. Manning, City of St. Paul, 170 City Hall Annex, 25 W Fourth Street, St. Paul, MN 55102.

258-267. Peter Margen, Studsvik Energiteknik AB, S-611 82 NYKOPING SWEDEN.

268. Frank W. Marshall, Seattle Steam Corporation, 1205 People's National Bank Building, Seattle, Washington 98171.

269. Amos Martin, St. Paul Area Chamber of Commerce, Osborn Building, St. Paul, MN 55102.

270. David M. Martin, Owatonna Public Utilities, Owatonna, MN 55060.

271. John Moen, Minnesota State Capital Annex, Administration Building, St. Paul, MN 55155.

272. Mathiason, Morehead State University, 1122 25th Avenue, South, Moorhead Minnesota 56560.

273. Robert Mauro, EPRI, P. O. Box 10412, Palo Alto, CA 94303.

274. Rene´ H. Maleś, EPRI, P. O. Box 10412, Palo Alto, CA 94303.

275. Thomas Maxwell, NYS Energy Office, Building 2 9th Floor, Rockefeller Plaza, Albany, NY 12223.

276. John McCabe, Rocet Research Company, York Center, Redmond, Washington, 98052.

277. Charles F. Meyer, General Electric TEMPO, P. O. Drawer QQ, Santa Barbara, California 93102.

278. James Mielke, Northern States Power Company, 360 Wabasha, St. Paul, MN 55102.

279. Eugene Miliczky, IDHA, 4377 Walden Avenue, Lancaster, NY 14086.

280. John Millhone, Department of Energy, 20 Massachusetts Avenue, Washington, D.C. 20545.

281. Paul D. Mitchell, Honeywell, Inc., 2301 Taft Street, NE, Minneapolis, MN 55418.

282. Thomas Mol, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

283. Mike Morris, General Electric, 5353 Gamble Drive, Minneapolis, MN 55415.

284. Alice Murphy, 347 City Hall, St. Paul, MN 55102.

285. Bradley Nelson, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55401.

286. Dallas E. Nelson, Litchfield Public Utilities, 421 West Third Street, Litchfield, MN 55355.

287. Luther Nelson, Hennepin County, 320 Washington Avenue, South, Hopkins, Minnesota 55343.

288. Wendel L. Nies, Minneapolis Public Schools, 1101 Third Avenue, S, Minneapolis, MN 55404.

289. Helge Nurmi, Detroit Edison Company 2000 Second, Detroit, MI 48236.

290-. Hans Nyman, District Heating, Minnesota Energy Agency, 150 E. Kellogg
299. Boulevard, St. Paul, MN 55101.

300. Ted C. Odenwald, General Manager, Municipal Utilities Commission, 704 Litchfield Avenue, SW, P. O. Box 937, Willmar, MN 56201.

301. I. Oliker, Burns & Roe Industrial Services Corporation, 496 Kinderkamack Road, Oradell, NJ 07649.

302. Cliff Olson, First National Bank, St. Paul, MN 55101.

303. Roger W. Olson, Metropolitan Medical Center, 900 S Eighth Street, Minneapolis, MN 55404.

304. John Pearce, 19785 Zebulon, Elk River, MN 55330.

305. R. B. Pearce, Consumers Power Company, Jackson, Michigan 49201.

306. Dewitt I. Pero, Syracuse University Steam Station, 500 E Taylor Street, Syracuse, NY 13202.

307. Eric Peterson, Department of Energy, DGRA, 12th and Penn, Washington, D.C. 20461.

308. John E. Peterson, Honeywell, Inc., 7515 12th Avenue South, Richfield MN 55423

309. John F. Petras, Westinghouse Electric, 469 Mt. Alverno Road, Media, Pennsylvania 19063.

310. C. W. Phillips, National Bureau of Standards, Building 225, Room A148, Washington, D.C. 20234.

311. Thomas M. Piascik, Public Service Electric and Gas Company, 80 Park Place, Room 6309, Newark, NJ 07101

312. Theodore Pietrini, Department of Public Utilities, 1906 Wolf Road, Virginia, MN 55792.

313. Dino Pirolo, Department of Public Utilities, 916 Seventh Avenue South, Virginia, MN 55792.

314. Frank J. Plourde, Northern States Power Company, Box 176B, Somerset, WI 54095.

315. Steven E. Pochardt, Upper Mississippi River Basin Commission, 4112 46th Avenue, South, Minneapolis, MN 55406.

316. Bruce F. Pyle, Glaus, Pyle, Schomer, Burns & Dehaven, 341 White Pond Drive, Akron, Ohio 44320.

317. William J. Rademacher, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55412.

318. Reynold S. Rahko, United Power Association, 706 Birch Street, Anoka, MN 55303.

319. James W. Ramsey, University of Minnesota, 2125 Unity Avenue, N, Minneapolis, Minnesota 55422.

320. Clifford E. Ramsted, St. Paul Port Authority, 25 E 4th Street, St. Paul, Minnesota 55101.

321. Ron Rasmussen, Iowa State University, IDHA, 1603 Truman Drive, Ames, Iowa 50010.

322. George L. Reichert, Northwestern University, Central Utility Plant, 2025 Sheridan Road, Evanston, Illinois 60201.

323. Don Reger, Engineering Sales, 311 W. 44th Street, Minneapolis, MN 55409.

324. William Reinhardt, Planner, State of Maryland, Energy Policy Office, 301 West Preston Street, Baltimore, Maryland 21202.

325. Gordon M. Reistad, Department of Mechancial Engineering, Oregon State University, Corvallis, Oregon 97331.

326. William Rice, Resource Applications, Department of Energy, Washington, D.C., 20545.

327. Francis B. Richerson, 3-M Company, 1600 Lamplight Drive, St. Paul, MN 55119.

328. Mack A. Riley, Alabama Power Company 15 S 20th Street, Birmingham, Alabama 35233.

329. Gene Robertson, Northern States Power Company, 9820 W. 16th Street, Minneapolis, MN 55415.

330-349. John Rodousakis, Department of Energy, Community Systems Branch, 20 Massachusetts Avenue, NW, Washington, D.C. 20545.

350. Glen Roningen, United Power Association, Highway 10, Elk River, MN 55330.

351. Thomas E. Root, Detroit Edison, 2000 Second Avenue, Detroit, Michigan 48226.

352. Jerome H. Rothenberg, Department of Housing & Urban Development, 451 Seventh Street, SW, Room 8158, Washington, D.C. 20410.

353-372. Alan Rubin, Department of Energy, Mail Stop B107, BLDG-GTN, Washington, D.C. 20545.

373. Harvey Sandstrom, Duluth Steam Coop. Association, 504 1st Federal Savings Building, Duluth, MN 55802.

374. Katherine E. Sasseville, Minnesota Public Service Commission, American Center Building, 150 E Kellogg Boulevard, St. Paul, MN 55101.

375. William F. Savage, Department of Energy, Mail Stop B-107, BLDG-GTN, Washington, D.C. 20545.

376. Maxine Savitz, Department of Energy, BLDG-20 Mass, Washington, D.C. 20545.

377. Gene A. Scales, Honeywell, Inc., 2600 Ridgeway Parkway, MN19-T113, Minneapolis, MN 55413.

378. John Schaefgen, National Bureau of Standards, Room A-146, Building 225, Washington, D.C. 20234.

379. Lee Schripper, Lawrence Berkley Labs, Berkley, Ca 94720.

380. Jack Schutz, Northern States Power Company, 414 Nicollet Mall, Minneapolis, Minnesota 55412.

381. Stan Selander, United Power Association, Highway 10, Elk River, MN 55330.

382. Isiah Sewell, Department of Energy, 20 Massachusetts Avenue, NW, Washington, D.C. 20545.

383. Larry Shaw, Regional Environmental Educational Council, 615 Oak Street Brainerd, MN 56401.

384. Joanne Showalter, 713 City Hall, St. Paul, MN 55102.

385. Bruce L. Shults, Public Service Company of Colorado, 7458 S Ogden Way, Littleton, Colorado 80120.

386. Arthur Siwarnock, Westinghouse Electric Company, 110 Locust Avenue, Springfield, PA 19064.

387. Walter Sinton, Westinghouse Electric Company, 2712 N Kent Road, Broomall, PA 19008.

388. Vertner J. Skretting, City of Minneapolis, Department of Public Works, Room 203, City Hall, Minneapolis, MN 55415.

389. John Slothower, Gilbert/Commonwealth, 2413 Indian Road, W, Minnetonka, Minnesota 55343.

390. Warren Soderberg, University of Minnesota, 200 Shops Building, Minneapolis, MN 55455.

391. Robert Staplin, Charles T. Main, Associates, Southeast Tower, Prudential Center, Boston, MA 02199.

392. Richard D. Starn, MPCA, 1935 W. Co, RD B-2, Roseville, MN 55113.

393. Vern E. Stelmack, Orr-Schelen-Mayeron & Associates, Inc., Suite 238, 2021 East Hennepin Avenue, Minneapolis, MN 55413.

394. Don Stephani, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

395. Sheldon Strauss, Power Magazine, McGraw Hill Publications, Company, 1221 Avenue of the Americas, New York, NY 10020.

396. Al Streb, Department of Energy, Mail Stop 2221C, 20 Massachusetts Avenue, NW, Washington, D.C. 20545.

397. Bo Strombo, AGA-CTC Heat Exchanger, AB, Box 60, 37201 Ronneby, SWEDEN.

398. Fred Strnisa, New York State Energy Research & Development Authority, Agency Building No. 2, Empire State Plaza, Albany, NY 12223.

399. John L. Sullivan, Con Edison, 27 Crescent Street, Hicksville, NY 11801.

400-419. Ronald Sundberg, Minnesota Energy Agency, American Center Building, 150 E Kellogg Boulevard, St. Paul, MN 55101.

420. Carl Sundquist, Department of Public Utilities, 806 Sixth Street, S, Virginia, MN 55792.

421. Mike Swedish, Wisconsin Electric Company, 231 W Michigan Street, Milwaukee, WI 53203.

422. Norman R. Taylor, Baltimore Gas & Electric Company, 1068 N. Front Street, Room 300, Baltimore, MD 21203.

423. Robert E. Terrell, Wisconsin Division of Planning & Energy, University of Wisconsin, Madison, WI 53702.

424. Raymond G. Tessmer, Jr., Brookhaven National Laboratory, Upton, NY 11973.

425. Mark Thornsjo, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

426. Ervin Timm, Energy Consumers Association, Osborn Building, St. Paul, MN 55102.

427. A. E. Toole, Department of Public Works, Sir Charles Tupper Building, Riverside Drive, Ottawa, Ontario CANADA K1A OM2

428. R. H. Tourin, Stone & Webster Engineering Corporation, New York Operations Center, One Penn Plaza, New York, NY 10001.

429. Lawrence E. Tuck, Boston Edison Company, 800 Boylston Street, Boston, MA 02199.

430. George F. Urbancik, Baltimore Gas & Electric Company, Lexington & Liberty Street, Baltimore, MD 21201.

431. John Vandermolen, University of Guelphy, 37 Havelock Street, Guelph (ONT) CANADA N1E-4G6.

432. Ron Visness, Minnesota Energy Agency, American Center Building, 150 E Kellogg Blvd., St. Paul, MN 55101.

433. David W. Wade, Georgia Institute of Technology, 225 North Avenue, Atlanta, GA 30332.

434. Omi G. Walden, Department of Energy, BLDG-20 Mass, Washington, D.C. 20545.

435. Warren L. Waleen, Minnegasco, 9525 Wayzata Blvd., Minneapolis, MN 55426.

436. Robert E. Walker, Ric-Wil, Inc., 10100 Brecksville Road, Brecksville, Ohio 44141.

437. Robert L. Waller, Pacific Gas & Electric Company, 18th & Shotwell Streets, San Francisco, CA 94110.

438. Ed Warn, St. Paul Planning Department, 1101 City Hall Annex, St. Paul, Minnesota 55102.

439. Emi L. Wasilowski, Strat. Systems, Inc., 11925 Larc Ind. Blvd., Barnsville, Minnesota 56514.

440. Roy E. Waters, Ontario Hydro, 700 University Avenue, Toronto, Ontario, CANADA.

441. Jean Westberg, Northern States Power Company, 3724 40th Avenue, S, Minneapolis, MN 55406.

442. Michael Whalen, Northern States Power Company, 5101 Eleanor Lane, Brooklyn Center, MN 55429.

443. Robert C. White, Worthington Municipal Utilities, 1022 Douglas Avenue, Worthington, MN 56187.

444. Earl Wick, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

445. David Wolfson, University of Minnesota, 319 15th Avenue, SE, Minneapolis, MN 55455.

446. David E. Wright, Rocketdyne Division, Rockwell International, Canoga Park, CA 91304.

447. J.S. Yampolsky, General Atomic Company, P. O. Box 81608, San Diego, California 91238.

448. Donald M. Youngdahl, Northern States Power Company, 414 Nicollet Mall, Minneapolis, MN 55401.

449. Assistant Manager, Energy Research and Development, DOE-ORO.

450– 766. Given distribution as shown in TID-4500 under UC-95d, Energy Conservation – Buildings and Community Systems. (25 copies – NTIS).